



Features

- Universal AC input / Full range
- · Protections: Short circuit / Overload / Over voltage
- Battery low protection / Battery reverse polarity protection by fuse
- Can be installed on DIN rail TS-35/7.5 or 15
- Alarm signal for AC OK and Battery low (via relay)
- Cooling by free air convection
- · LED indicator for power on
- · 100% full load burn-in test
- 3 years warranty

Applications

- Security system
- · Emergency lighting system
- · Alarm system
- · DC UPS system
- · Central monitoring system
- · Access systems


■ GTIN CODE

MW Search: https://www.meanwell.com/serviceGTIN.aspx

Description

DRC-100 is a 96W AC/DC DIN rail type security power supply series. In addition to the primary output, there is a charger output with a smaller rated current, enabling the backup power supply application the security access systems require. DRC-100 accepts the universal input between 90VAC and 264VAC, and supplies 13.8VDC and 27.6VDC at output, respectively. With the efficiency up to 89%, it can operate with air convection cooling under -30°C through 70°C. In addition to the key protection features such as overload protection, over voltage protection, battery low cut off, and battery reverse polarity protection (by fuse), the alarm signal for AC OK and battery low signaling is provided, via relay contact output, to facilitate the system design.

Model Encoding






SPECIFICATION

OUTPUT NUMBER	CH1					
	0111	CH2	CH1	CH2		
DC VOLTAGE	13.8V	13.8V	27.6V	27.6V		
RATED CURRENT	4.5A	2.5A	2.25A	1.25A		
CURRENT RANGE	0 ~ 7A		0 ~ 3.5A			
RATED POWER	96.6W		96.6W			
, ,	· ' ·					
	111					
		2400ms 50ms/115\/AC				
·						
			tion noscible by connecting	α Λ C / Ι / ± \ Λ C / N / \ \ \		
` • · ·						
INRUSH CURRENT (Typ.)						
OVERLOAD						
OVER VOLTAGE						
BATTERY CUT OFF						
AC OK						
BATTERY I OW	Relay contact output, OFF: Battery OK; ON: Battery Low; max. rating: 30V/1A					
DATTERT LOW	Battery low voltage : < 11V Battery low voltage : < 22V					
WORKING TEMP.	-30 ~ +70°C (Refer to "Derating Curve")					
WORKING HUMIDITY	20 ~ 90% RH non-condensing					
STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH					
TEMP. COEFFICIENT	$\pm 0.03\%$ /°C (0 ~ 50°C) on CH1 output					
VIBRATION	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes					
SAFETY STANDARDS	UL62368-1, TUV BS EN/EN62368-1, EAC TP TC 004, AS/NZS 60950.1 approved					
WITHSTAND VOLTAGE	I/P-O/P:3KVAC I/P-FG:2KVAC O/P-FG:0.5KVAC					
ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH					
EMC EMISSION	Compliance to BS EN/EN55032 (CISPR32) Class B, BS EN/EN61000-3-2,-3, EAC TP TC 020					
EMC IMMUNITY	Compliance to BS EN/EN61000-4-2,3,4,5,6,8,11,BS EN/EN55035,BS EN/EN61204-3, light industry level, EAC TP TC 020; meet BS EN/EN54-4 for fire detection and fire alarm systems					
MTBF						
DIMENSION	55*90*100mm (W*H*D)					
PACKING	0.37Kg; 30pcs/12.1Kg/0.82	CUFT				
 All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature. Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1uf & 47uf parallel capacitor. Tolerance: includes set up tolerance, line regulation and load regulation. Length of set up time is measured at cold first start. Turning ON/OFF the power supply may lead to increase of the set up time. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) Installation clearances: 40mm on top, 20mm on the bottom, 5mm on the left and right side are recommended when loaded permanently with full power. In case the adjacent device is a heat source, 15mm clearance is recommended. The ambient temperature derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500ft). 						
	VOLTAGE ADJ. RANGE VOLTAGE TOLERANCE Note.3 LINE REGULATION LOAD REGULATION SETUP, RISE TIME Note.4 HOLD UP TIME (Typ.) VOLTAGE RANGE FREQUENCY RANGE EFFICIENCY (Typ.) AC CURRENT (Typ.) INRUSH CURRENT (Typ.) OVERLOAD OVER VOLTAGE BATTERY CUT OFF AC OK BATTERY LOW WORKING TEMP. WORKING HUMIDITY STORAGE TEMP., HUMIDITY TEMP. COEFFICIENT VIBRATION SAFETY STANDARDS WITHSTAND VOLTAGE ISOLATION RESISTANCE EMC EMISSION EMC IMMUNITY MTBF DIMENSION PACKING 1. All parameters NOT specific services are means and the services are mea	VOLTAGE TOLERANCE Note.3 LINE REGULATION LOAD REGULATION ET 0.5% SETUP, RISE TIME Note.4 HOLD UP TIME (Typ.) VOLTAGE RANGE FREQUENCY RANGE EFFICIENCY (Typ.) AC CURRENT (Typ.) OVERLOAD OVERLOAD OVER VOLTAGE BATTERY CUT OFF AC OK BATTERY LOW BATTERY LOW WORKING TEMP. WORKING TEMP. WORKING HUMIDITY STORAGE TEMP., HUMIDITY TEMP. COEFFICIENT VIDENAL STANDARDS WITHSTAND VOLTAGE BIOLATION RESISTANCE EMC EMISSION CMI DATAGE SPO*100mm (W*H*D) PACKING 1. All parameters NOT specially mentioned are measured at 20MHz of bardwing 1. Composition of the premainently with full power. In case the adjacent of apprendiction of the premainently with full power. In case the adjacent of the premainent of the premainen	VOLTAGE ADJ. RANGE VOLTAGE TOLERANCE Note.3 ±1.0% LINE REGULATION ±0.5% LOAD REGULATION ±0.5% SETUP, RISE TIME Note.4 2400ms, 50ms/230VAC 2400ms, 50ms/115VAC HOLD UP TIME (Typ.) 50ms/230VAC 10ms/115VAC at full load VOLTAGE RANGE 90 ~ 264VAC 127 ~ 370VDC [DC input opera FREQUENCY RANGE 47 ~ 63Hz EFFICIENCY (Typ.) 87%	VOLTAGE ADJ. RANGE CH1:12 ~ 15V CH1:24 ~ 30V VOLTAGE TOLERANCE Notes ± 1.0% ± 1.0% ± 1.0% LINE REGULATION ± 0.5% ± 0.5% ± 0.5% SETUP, RISE TIME Notes 4200ms, 50ms/230VAC 2400ms, 50ms/115VAC at full load HOLD UP TIME (Typ.) 50ms/230VAC 10ms/115VAC at full load VOLTAGE RANGE 90 ~ 264VAC 127 ~ 370VDC [DC input operation possible by connectin FREQUENCY RANGE 47 ~ 63Hz 89% 89% AC CURRENT (Typ.) 1.8A/115VAC 1.1A/230VAC 105 ~ 150% rated output power POVER LOAD Protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by protection type: Hiccup mode, recovers automatically after fault condition is reported by pre		

% Product Liability Disclaimer: For detailed information, please refer to https://www.meanwell.com/serviceDisclaimer.aspx



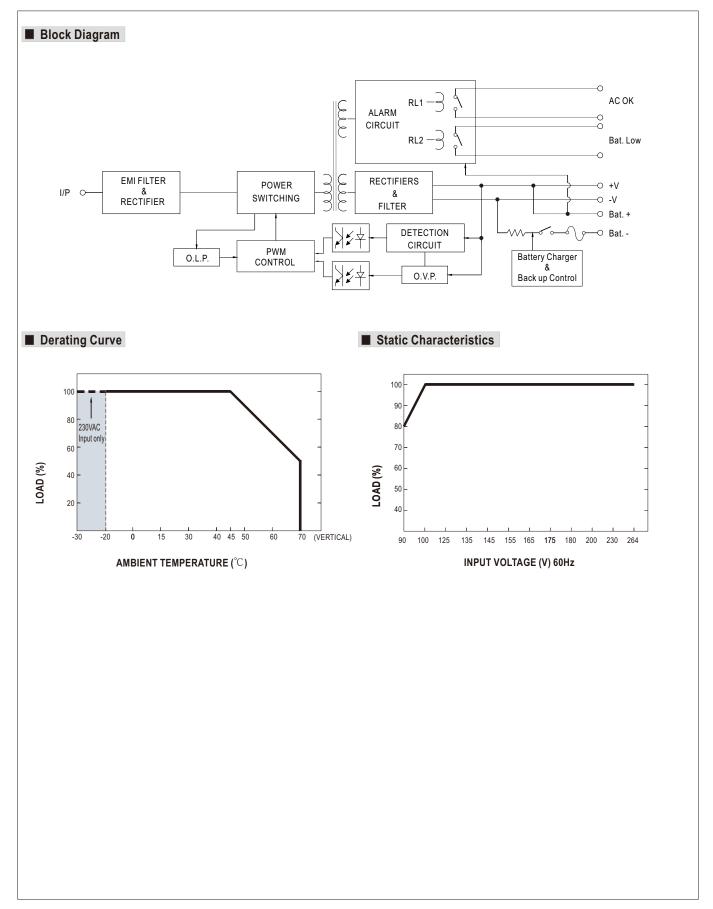



■ Suggested Application

1.Backup connection for AC interruption

(1) Please refer to Fig1.1 for suggested connection.

The power supply charges the battery and provides energy to the load at the same time when AC mains is OK.

The battery starts to supply power to the load when AC mains fails.

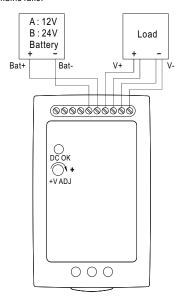


Fig 1.1 Suggested system connection

2. Alarm signal for AC OK and battery low

- (1) Alarm signal is sent out through "AC OK " & " Battery Low " pins via relay contact.
- $(2) \, \text{An external voltage source is required for this function.} \, \text{The maximum applied voltage is 30V and the maximum sink current is 1A.} \, Please \, \text{refer to Fig 2.2.}$
- (3) Table 2.1 explains the alarm function built in the power supply
- (4) AC OK signal (RL1, referring to Block Diagram) will go into hiccup mode when the overload protection is activated.

Function	Description	Output of alarm	
1001	The signal is "Low" when the power supply turns ON.	Low or short	
AC OK	The signal turns to be "High" when the power supply turns OFF.	High or open (External applied voltage 30V max.)	
Pottory Low	The signal is "Low" when the voltage of battery is under A:11V, B:22V.	Low or short	
Battery Low	The signal is "High" when the voltage of battery is above A:11V, B:22V.	High or open (External applied voltage 30V max.)	

Table 2.1 Explanation of alarm signal


AC OK (Battery low) PIN8(10) R External voltage sorece (V) and resistor (R) (The max. Sink is 1A and 30V)


Fig 2.2 Internal circuit of AC OK (Battery Low), via relay contact





■ Mechanical Specification


Case No.973A Unit:mm












Terminal Pin No. Assignment (TB1):

Pin No.	Assignment	
1	AC/L or DC+	
2	AC/N or DC-	
3	FG ÷	

Terminal Pin No. Assignment (TB2):

romman mirro, reeignment (122).							
	Pin No.	Assignment	Pin No.	Assignment			
	1,2	-V	6	Bat			
	3,4	+V	7,8	AC OK			
	5	Bat. +	9,10	Bat. Low			

■ Installation Instruction



This series fits DIN rail TS35/7.5 or TS35/15. For installation details, please refer to the Instruction manual.

 $ADMISSIBLE\ DIN\ rail: TS35/7.5\ OR\ TS35/15$ (For reference only. Not included with unit.)

Back View

■ Installation Manual

Please refer to: http://www.meanwell.com/manual.html